
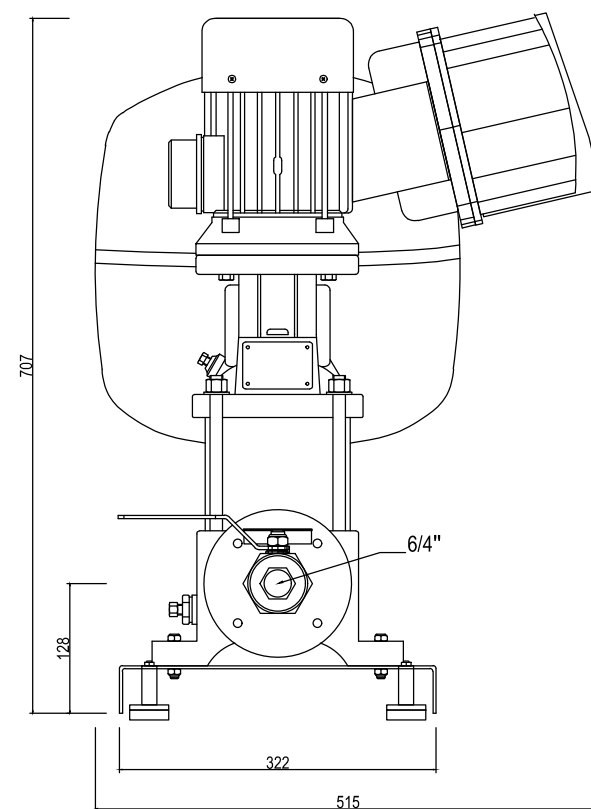


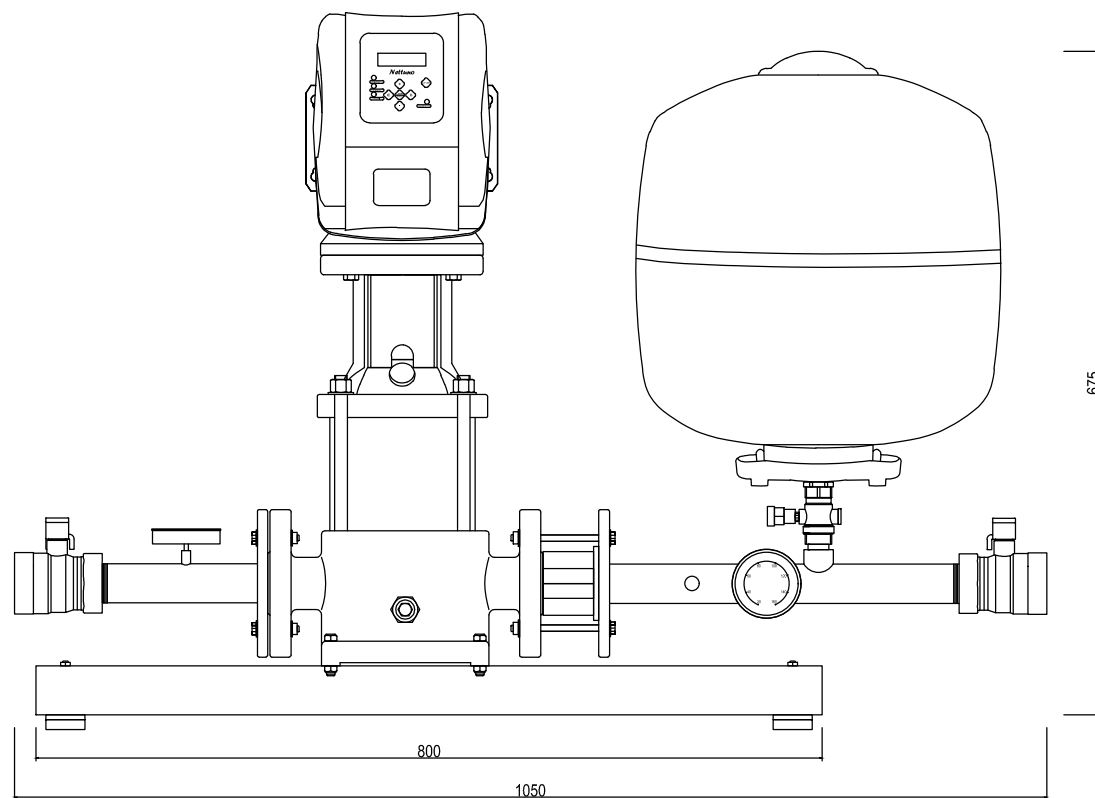

FGJ(DIN-ANSI-JIS) PN25(DN40) /mm/

BATS-E CVE 10-4

PUMPS

13.11.2020

Textilná 3/A

040 12 Košice

